

TankScan Cellular Industrial Gateway Setup Instructions

TankScan | Powered by AquaPhoenix

IMPORTANT: Gateway must be installed before installing monitor batteries or battery life will be severely compromised.

System Components:


- Industrial Gateway
- XBees Antenna
- Cellular Antennas
- Power Supply

Determine Gateway Location

- 1 Locate gateway near 115VAC outlet so it is within a 1000 ft range of TankScan monitors and has a clear line of sight to those monitors. If gateway is to be within a structure, keep in mind that anytime a radio signal passes through walls its strength will lessen. Metal walls will weaken signals significantly. Also, gateway life is shortened by exposure to dirt and water, so in cases where gateway is not protected by a structure it is then necessary to place gateway in a water/dust tight box.

Set Up Gateway

- 2 Unpack gateway from box.
- 3 Connect XBee antenna to XBee connector.
- 4 Connect a cellular antenna to each WWAN connector.
- 5 Connect power supply.
- 6 With power connected lights will illuminate as follows:
 - Power indicator will turn solid blue.
 - XBee indicator flashes green when monitors can connect with gateway.
 - Network indicator gradually turns solid green when connectivity with Internet is achieved.
 - Signal Strength indicator will turn either yellow or green, depending on the cellular signal strength.

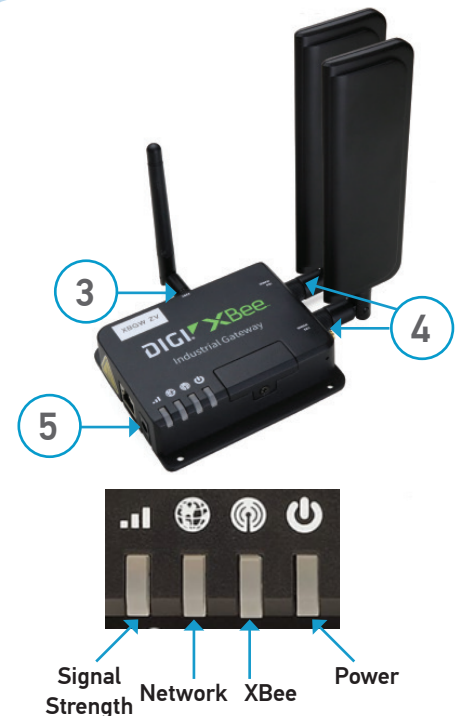

For help call TankScan Technical Support at 877-847-7226.

To comply with FCC and Industry Canada RF radiation exposure limits for general population, the gateway and monitor must be installed to provide a separation distance of at least 20cm from all persons and they must not be co-located or operated in conjunction with any other antennas or transmitters.

Changes or modifications not expressly approved by AquaPhoenix Scientific could void the user's authority to operate the equipment. This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at their expense.

223-0178-000 Rev. B 7/14

AquaPhoenix Scientific
860 Gitts Run Road
Hanover, PA 17331

PH: 877-847-7226

www.tankscan.com



©2025 AquaPhoenix. All Rights Reserved. TankScan images and marketing materials are protected by various patents, copyrights and/or trademarks. AquaPhoenix assumes no responsibility for any errors which may appear in this document, reserves the right to change devices or specifications detailed herein at any time without notice, and does not make any commitment to update the information contained herein. No licenses to patents or other intellectual property of AquaPhoenix are granted by the Company in connection with the sale of TankScan products, expressly or by implication.